

# Certificate of Conformity

Certificate Number: CN-PV-230146

On the basis of the tests undertaken, the sample<s> of the below product have been found to comply with the requirements of the referenced specification<s>/standard<s> at the time the tests were carried out. It does not imply that Intertek has performed any surveillance or control of the manufacture(s). The manufacturer(s) shall ensure that the manufacturing process assures compliance of the production units with the examined products mentioned in this certificate.

<b>Applicant:</b>	Shenzhen Growatt New Energy Co., Ltd. 4-13/F,Building A,Sino-German(Europe) Industrial Park,Hangcheng Ave,Bao'an District,Shenzhen,China
<b>Product:</b>	PV Grid Inverter
<b>Ratings &amp; Principle Characteristics:</b>	See appendix of Certificate of Conformity
<b>Model:</b>	MID 17KTL3-X2, MID 20KTL3-X2, MID 25KTL3-X2, MID 30KTL3-X2, MID 30KTL3-X2-1, MID 33KTL3-X2, MID 36KTL3-X2, MID 40KTL3-X2, MID 50KTL3-X2
<b>Brand Name&lt;s&gt;:</b>	GROWATT
<b>Product Complies with:</b>	CEI 0-21:2022-03 + V1:2022-11: Reference technical rules for the connection of active and passive users to the LV electrical Utilities
<b>Certificate Issuing Office Name &amp; Address:</b>	Intertek Testing Services Ltd. Shanghai West Area, 2 <sup>nd</sup> Floor, No. 707, Zhangyang Road China (Shanghai) Pilot Free Trade Zone, Shanghai, P. R. China Accredited by ACCREDIA in accordance with ISO/IEC 17065:2012
<b>Test Report No.&lt;s&gt;:</b>	221226019GZU-001 Issued by Intertek Testing Services Shenzhen Ltd. Guangzhou Branch accredited by IAS (TL-395) in accordance with ISO/IEC 17025:2017

Additional information in Appendix.



**Signature**

**Certification Manager: Grady Ye**

**Date: 04 April 2023**



PRD N° 306B

This Certificate is for the exclusive use of Intertek's client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Certificate. Only the Client is authorized to permit copying or distribution of this Certificate. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.

## APPENDIX: Certificate of Conformity

This is an Appendix to Certificate of Conformity Number: CN-PV-230146.


Model	MID 17KTL3- X2	MID 20KTL3- X2	MID 25KTL3- X2	MID 30KTL3- X2	MID 30KTL3- X2-1	MID 33KTL3- X2	MID 36KTL3- X2	MID 40KTL3- X2	MID 50KTL3- X2
Max. DC voltage	1100Vdc								
MPP voltage range	200-1000Vdc								
Full Load MPP voltage range	420-850Vdc		480-850Vdc		400-850Vdc			450-850Vdc	
No. of MPP trackers	2				3			4	
No. of PV strings per MPP trackers	2/2			2/3		2/2/2		2/2/2/2	
Max. input current per MPP trackers [A]	32/32		32/36	32/48	32/32/32			32/32/32/32	
Max. short-circuit current per MPP trackers [A]	40/40		40/45	40/60	40/40/40			40/40/40/40	
AC rated power [KW]	17	20	25	30	30	33	36	40	50
Max. AC apparent power [KVA]	18.8	22.2	27.7	33.3	30.0	36.6	40.0	44.4	55.5
Rated AC voltage	3W/N/PE, 230V/400V								
AC grid frequency	50/60Hz								
Rated AC output current [A]	24.6	29.0	36.2	43.5	43.5	47.8	52.2	58.0	72.5
Max. output current [A]	28.6	33.6	42.0	50.5	45.5	55.5	60.6	67.3	84.1
Adjustable power factor	0.8Leading ...0.8Lagging								
Operating temperature range	-25°C ... +60°C (>45°C Derating)								
Protection degree	IP66								
Software Version	DM1.0								

This Certificate is for the exclusive use of Intertek's client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Certificate. Only the Client is authorized to permit copying or distribution of this Certificate. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.

## APPENDIX: Certificate of Conformity

This is an Appendix to Certificate of Conformity Number: CN-PV-230146.

TYPE OF APPARATUS: PV Grid Inverter			
Number of phases: three-phase			
DISCONNECTION DEVICE	INTERFACE PROTECTION DEVICE	DEVICE FOR CONVERSION	ROTATING GENERATOR DEVICE
		<input checked="" type="checkbox"/>	
<p>The static converters in systems with capacity more than 11.08 kW            The devices are capable to limit Idc to 0.5% of the rated grid current            Having examined the ISO 9001 certificate of the manufacturer No: 02421Q32012223R0M, issued by:            UNIVERSAL CERTIFICATION CENTRE CO., LTD</p>			

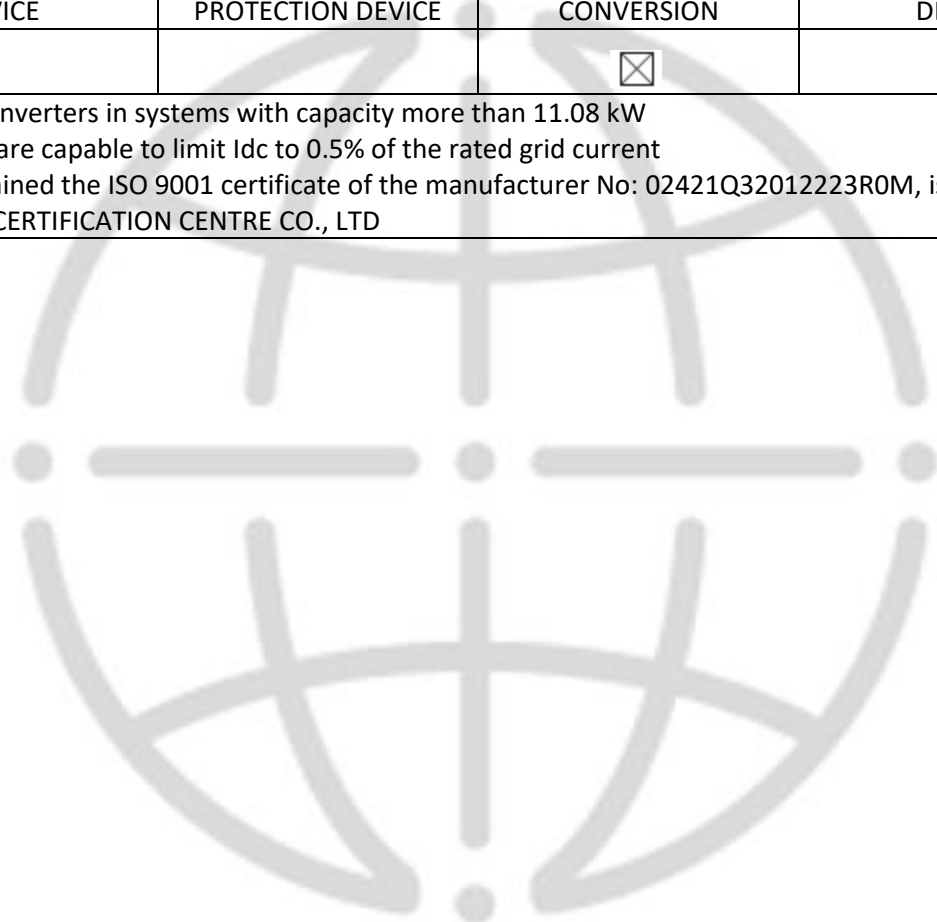

This Certificate is for the exclusive use of Intertek's client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Certificate. Only the Client is authorized to permit copying or distribution of this Certificate. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.